

Randy Cole
Regenerative Research
Denver, CO 80210




Project 135394
Lab # 129681
Date Rec'd 10/10/2025
Report Issued 10/22/2025

Project

Sample GLOW 70 mg

Certificate of Analysis

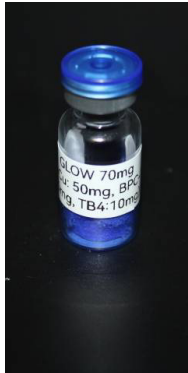

<u>Analyte</u>	<u>Result</u>	<u>LOQ</u>	<u>Units</u>	<u>Method</u>	<u>Date</u>	<u>% of Label</u>
Microbiology						
Endotoxins	ND	1	EU/mL	USP 85	10/15/2025	
Peptide Analysis						
Chromatographic purity	99.0		%	HPLC-UV/MS	10/19/2025	
BPC-157	9.37	0.5	mg	HPLC-UV-MS	10/19/2025	93.66
BPC-157	ID Confirmed			HPLC-UV-MS	10/19/2025	
GHK-Cu	55.5	0.5	mg	HPLC-UV-MS	10/19/2025	110.93
GHK-Cu	ID Confirmed			HPLC-UV-MS	10/19/2025	
Thymosin β 4	8.90	0.5	mg	HPLC-UV-MS	10/19/2025	88.98
Thymosin β 4	ID Confirmed			HPLC-UV-MS	10/19/2025	

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
Methods shown reference current Krause Analytical SOPs
ND - Not detected LOQ - limit of quantification
Copyright © 2025 Krause Analytical LLC. All rights reserved.


Respectfully submitted,

Mark C. Krause
Laboratory Director


**krause analytical**

Chromatogram

Response_

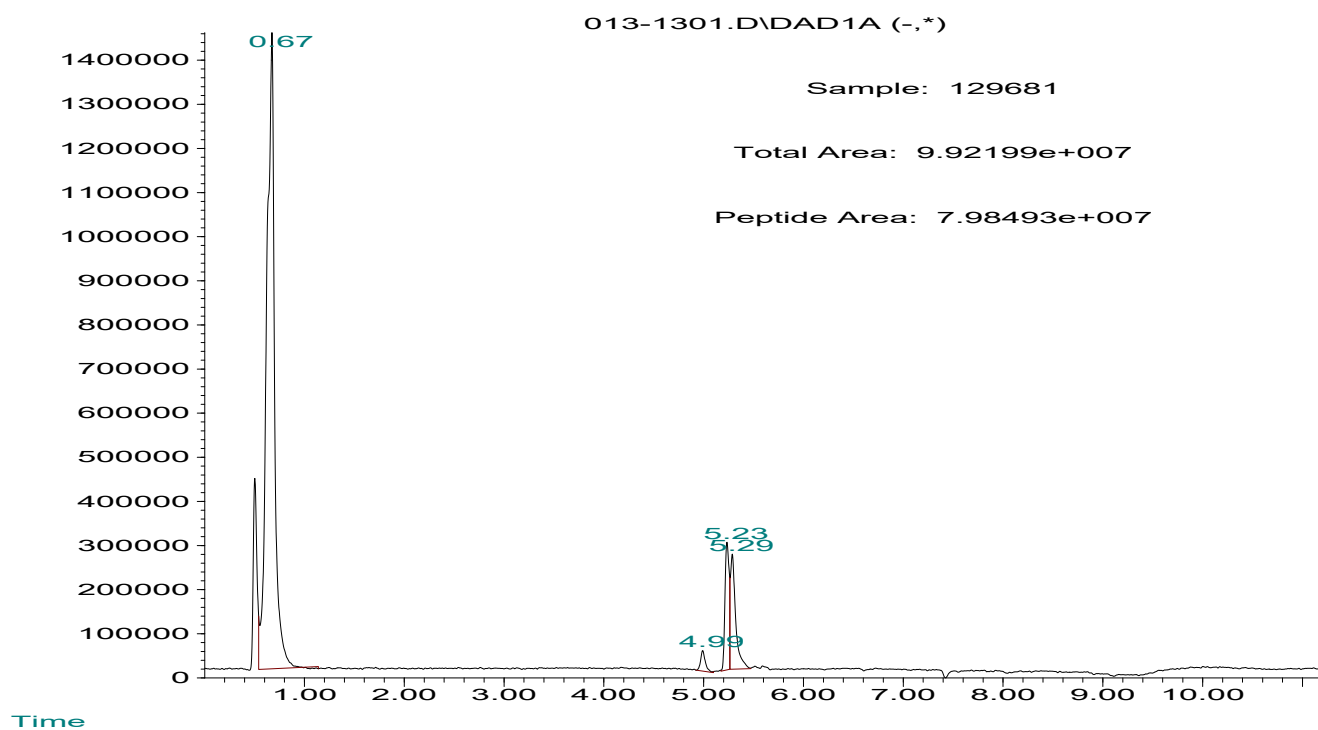


Mass spectrum/Reference Spectrum

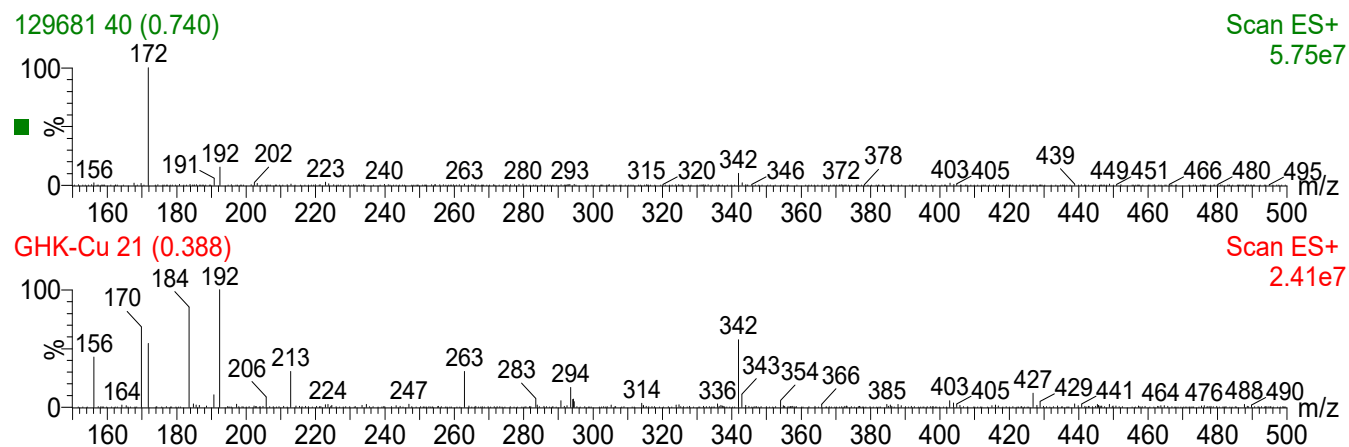


**krause analytical**


129681 232 (4.292)

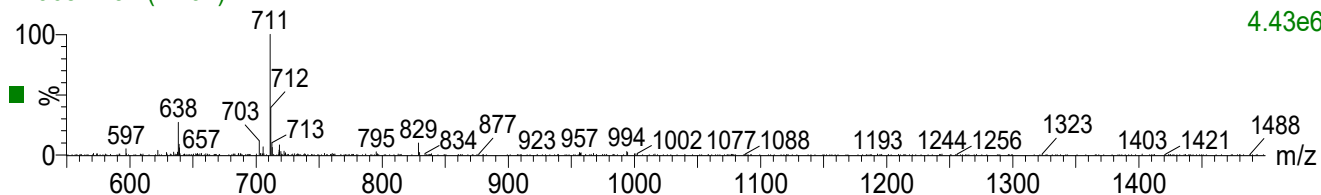Scan ES+
4.43e6

Thymosin b4 16 (0.296)

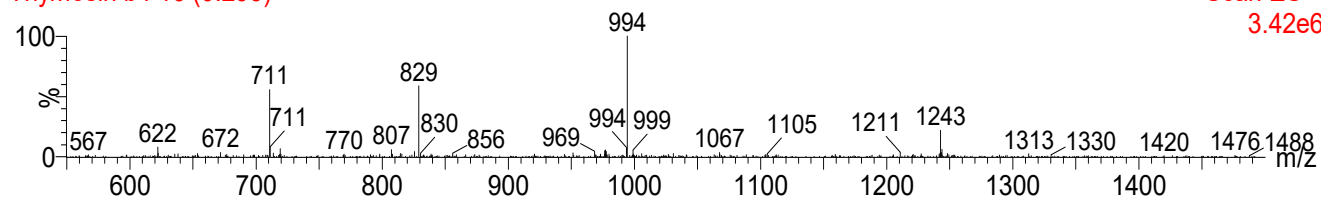Scan ES+
3.42e6

129681 222 (4.107)

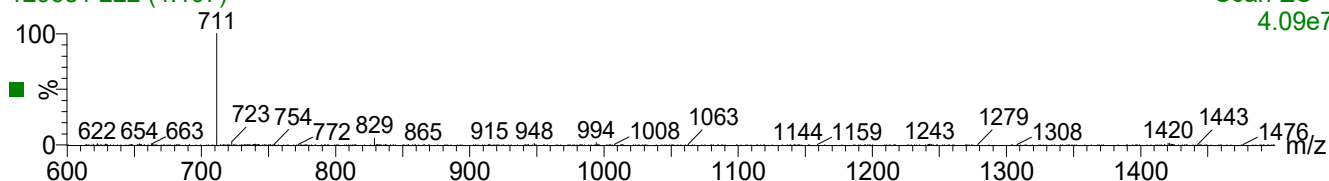Scan ES+
4.09e7

BPC-157 29 (0.536)

Scan ES+
2.21e7