

Randy Cole
Regenerative Research
Denver, CO 80210



Project 135479
Lab # 130210
Date Rec'd 11/12/2025
Report Issued 11/24/2025


Project

Sample KPV 30 mg (KV25-02)

Certificate of Analysis



<u>Analyte</u>	<u>Result</u>	<u>LOQ</u>	<u>Units</u>	<u>Method</u>	<u>Date</u>	<u>% of Label</u>
Microbiology						
Endotoxins	ND	1	EU/mL	USP 85	11/21/2025	
Peptide Analysis						
Chromatographic purity	99.77	0.5	%	HPLC-UV/MS	11/19/2025	
Total peptide mass	24.2	0.5	mg	HPLC-UV/MS	11/19/2025	80.7
KPV	ID Confirmed			HPLC-UV-MS	11/19/2025	

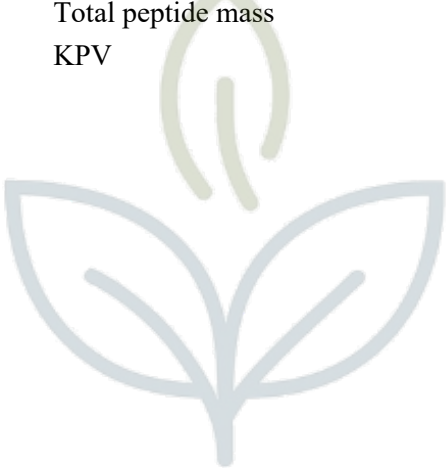

REGENERATIVE RESEARCH

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
Methods shown reference current Krause Analytical SOPs
ND - Not detected LOQ - limit of quantification
Copyright © 2025 Krause Analytical LLC. All rights reserved.


Respectfully submitted,

Mark C. Krause
Laboratory Director



Chromatogram

Response_

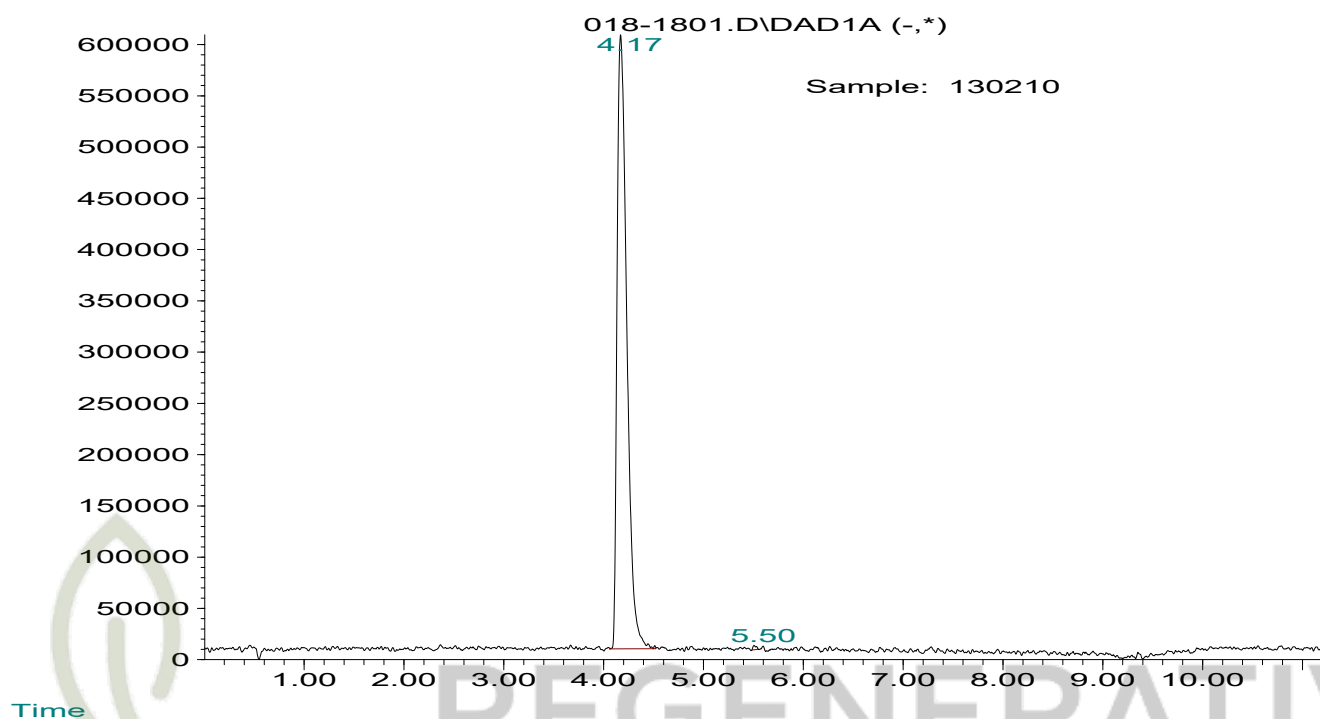

Mass spectrum/Reference Spectrum

